DEMOLITION NOTES THIS SHEET

1. REMOVE HWS/HWR PIPING, HANGERS AND SUPPORTS COMPLETE TO POINT INDICATED.
2. REMOVE WALL MOUNTED THERMOSTAT AND CONTROL WIRING COMPLETE.
3. REMOVE WALL MOUNTED THERMOSTAT AND CONTROL WIRING AND STORE FOR REINSTALLATION.

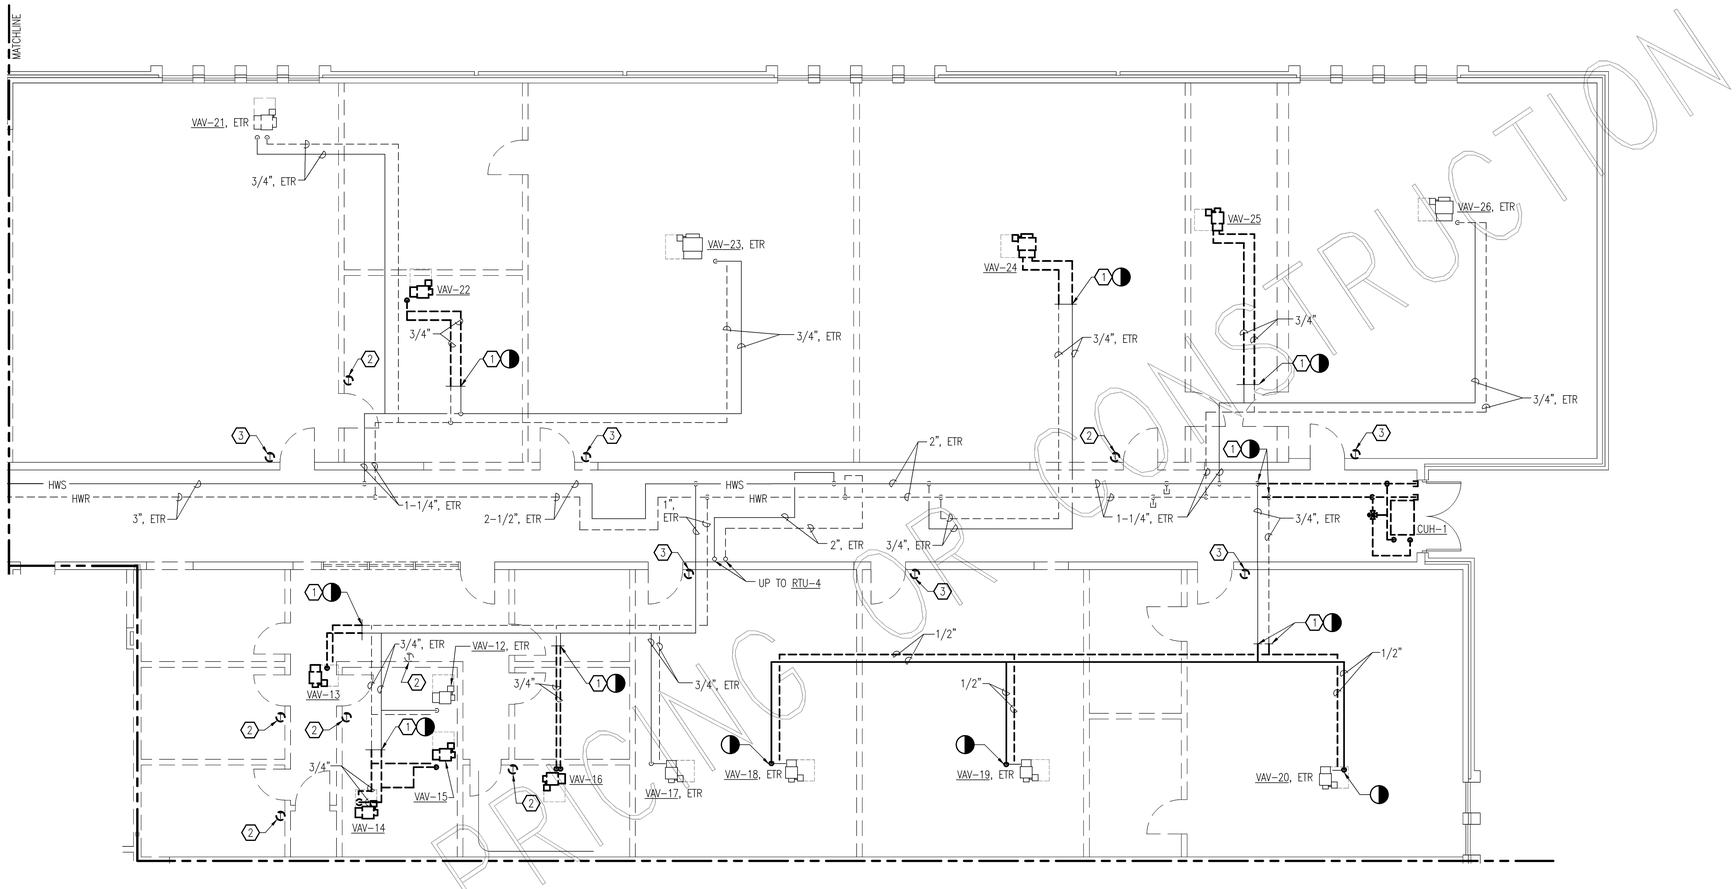

DEMOLITION FLOOR PLAN – MECHANICAL PIPING

SCALE: 3/16" = 1'-0"

NOT FOR CONSTRUCTION
NOT FOR PRICING

ASBESTOS AND LEAD PAINT NOTE

AN ASBESTOS INSPECTION WAS PERFORMED AND ASBESTOS CONTAINING MATERIALS WERE FOUND GENERALLY IN THE AREAS INDICATED IN THE ASBESTOS SURVEY/INSPECTION REPORT WHICH IS AVAILABLE TO THE CONTRACTOR(S) FOR HIS INFORMATION. ASBESTOS CONTAINING MATERIALS HAVE BEEN REMOVED UNDER A SEPARATE CONTRACT.

A LEAD-BASED PAINT INSPECTION WAS PERFORMED AND LEAD-BASED PAINT WAS FOUND IN THE AREAS INDICATED. THE CONTRACTOR SHALL BE RESPONSIBLE WITH ALL REQUIREMENTS OF THE VIRGINIA OCCUPATIONAL SAFETY AND HEALTH ADMINISTRATION REGULATIONS LEAD-BASED PAINT PROTECTION OF WORKERS.



KEYPLAN
NO SCALE

GRAPHIC SCALES

3/16" = 1'-0" 0' 5' 10' 20'

nbj ARCHITECTURE
A Professional Limited Company
GROVE PARK SQUARE
11537-B NUCKOLS ROAD
Richmond, Virginia 23059
(804) 273-9811 fax: (804) 273-9843

RAPPAHANNOCK COMMUNITY COLLEGE
CAMPUS RENOVATIONS
WARSAW + GLENNS, VIRGINIA
PC: 260-17712

WARSAW CAMPUS DEMOLITION
FLOOR PLAN – MECHANICAL PIPING

Date: JANUARY 13, 2010

REVISIONS

NO.	DATE

PACE COLLABORATIVE
MECHANICAL ELECTRICAL ENGINEERS
VIRGINIA BEACH, VA - 757-490-7220

COMMONWEALTH OF VIRGINIA
JOHN M. NEWELL
Lic. No. 035329
01.13.10
PROFESSIONAL ENGINEER

Sheet
MD2.5W

File Number
XX